


Column Anchor – Use Simpson Strongtie CB Column Base (3 gauge min. thickness for straps and base), or equivalent.

Place building column, where applicable

Inside Structure

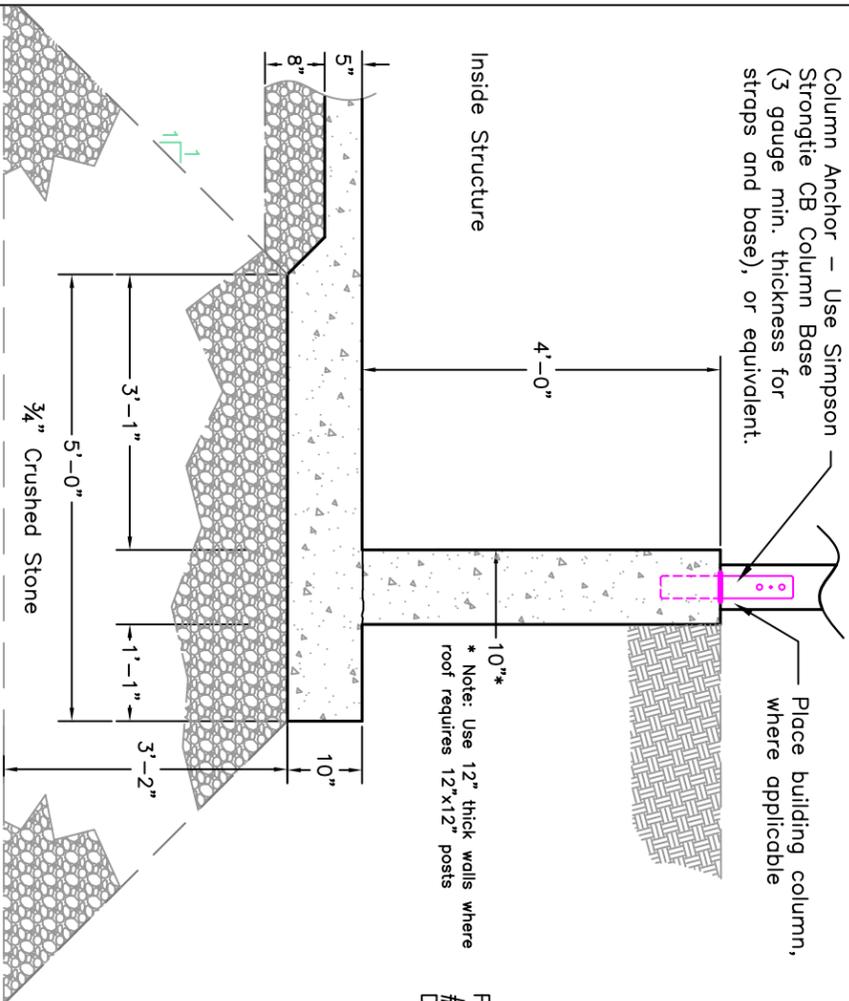

* Note: Use 12" thick walls where roof requires 12"x12" posts

SCALE 1/2" = 1'

| MARK | SIZE | QUANTITY | TYPE | A | B | LENGTH | TOTAL LENGTH |
|------|------|----------|-------------------|-------|-----|--------|--------------|
| C1 | 4 | 4 | Straight | - | - | 5'-5" | |
| C2 | 4 | 4 | 21 | 4'-9" | 8" | 5'-5" | |
| C3 | 4 | 4 | 21 | 4'-9" | 8" | 5'-5" | |
| C4 | 4 | 4 | 180° HOOK FA. END | - | - | 5'-7" | |
| C5 | 4 | 4 | Straight | - | - | 5'-1" | |
| C6 | 4 | 4 | 180° HOOK ONE END | - | - | 5'-1" | |
| C7 | 4 | 4 | 22 | 2'-7" | 5"* | 5'-7"* | |
| C8 | 4 | 4 | Straight | - | - | 3'-7" | |

* 7" @ 12" WALL

** 5'-9" @ 12" WALL

#4 BARS, TOTAL LENGTH = _____ X 0.668 LBS/FT. = _____ LBS

CONCRETE = 0.278 CY/FT. OF WALL LENGTH ESTIMATED TOTAL = _____ CY

NOTE: QUANTITIES OF STEEL SHOWN DO NOT INCLUDE LAP SPLICE OR DEVELOPMENT LENGTHS.

MINIMUM LAP SPLICE


#4 bars = 1'-8"

TYPE 22 BAR TYPE 21 BAR




WASTE STORAGE FACILITY
4' HIGH WALL WITH COLUMNS
3' TO 4' BACKFILL


STANDARD DWG. NO. MA-WSF-10 RF
DATE May 2012 SHEET 1 OF 1

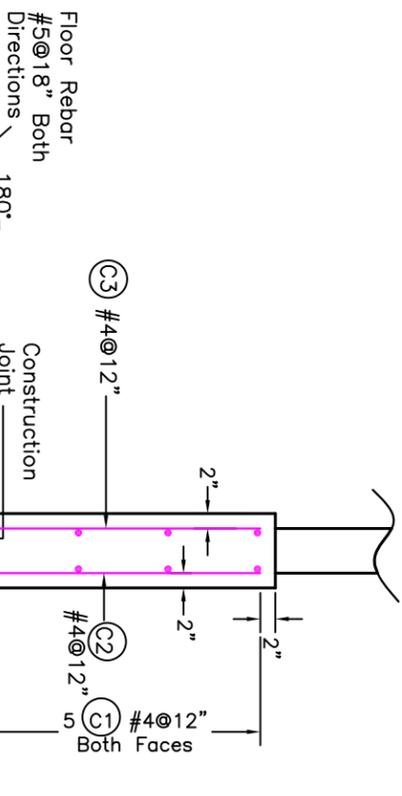

SCALE 1/2" = 1'

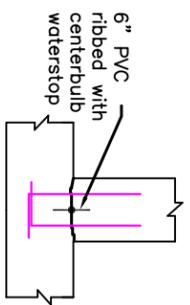

CONSTRUCTION JOINT DETAIL
NOT TO SCALE

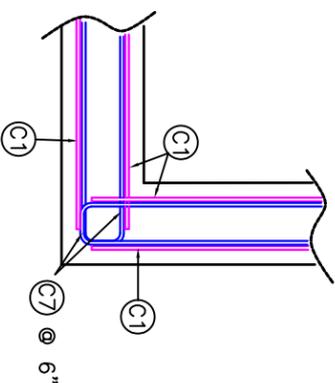


WALL CORNER DETAIL
NOT TO SCALE

CRUSHED STONE SPECIFICATION

Crushed stone shall consist of durable crushed rock or durable crushed gravel stone, free from ice and snow, sand, clay, loam, or other deleterious or organic material. Crushed stone shall be used as bedding below slabs-on-grade and foundation wall footings with thickness as indicated on the drawings. Crushed stone shall be wrapped in non-woven filter fabric 6-oz/sy, placed in maximum 6-inch thick layers, loose measure, and compacted with a minimum of four passes of a vibratory plate or roller conform to the following requirements:

| Sieve Size | Percent Passing by Weight |
|------------|---------------------------|
| 1-inch | 100 |
| 3/4-inch | 90-100 |
| 5/8-inch | --- |
| 1/2-inch | 10-50 |
| 3/8-inch | 0-20 |
| No. 4 | 0-5 |
| No. 8 | --- |

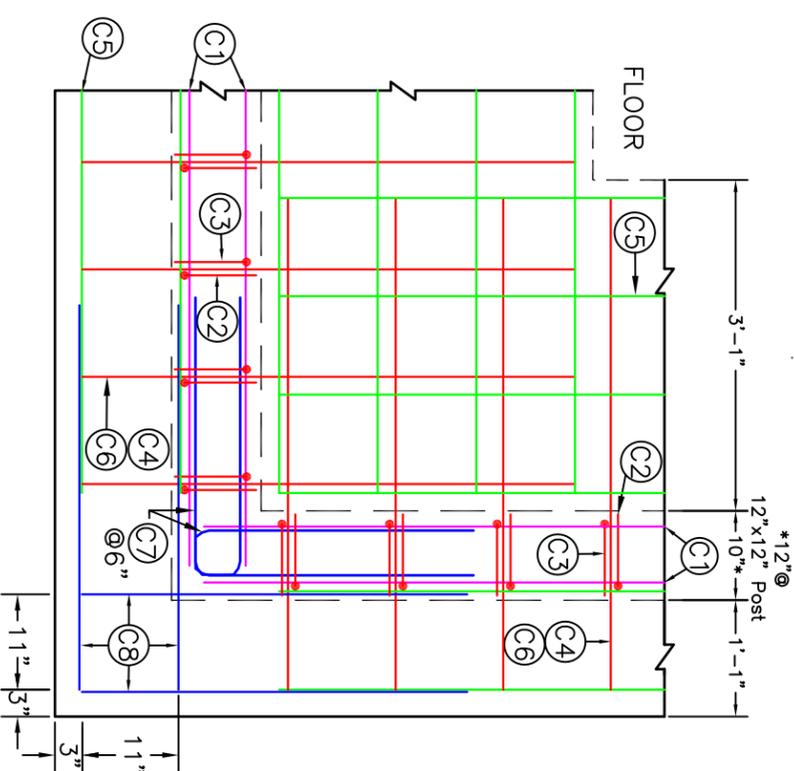

CORNER DETAIL (PLAN VIEW)
NOT TO SCALE

WALL DESIGN LOADING

- * MANURE LOADING = 65 pcf
- * BACKFILL: GRANULAR, NON-COHESIVE
- * DENSITY = 120 pcf; $\phi = 30^\circ$
- * SURCHARGE = 2' OF BACKFILL EQUIVALENT (120 psf EFP REPRESENTING MACHINERY LOAD ON SOIL)

CONSTRUCTION

- * CONTRACTION JOINTS SHALL BE PLACED IN WALLS AT A MAXIMUM SPACING OF 30'.
- * EXPANSION JOINTS IN THE FLOOR SLABS SHALL BE A MAXIMUM OF 25', THE SUBBASE MATERIAL UNDER THE SLAB SHALL BE 3/4" CRUSHED STONE AS INDICATED ON THE DRAWINGS. SEE PROJECT DRAWINGS AND SPECS FOR ADDITIONAL SUBBASE REQUIREMENTS.
- * UNLESS OTHERWISE SHOWN, PROVIDE A MINIMUM OF 2" OF CONCRETE COVER OVER ALL STEEL.
- * ALL CONTRACTION AND EXPANSION JOINTS SHALL HAVE WATERSTOPS.
- * DRAINAGE SHALL BE DIRECTED AWAY FROM THE WALL.
- * THE TOP WIDTH OF THE BACKFILL AROUND THE WALL SHALL BE AT LEAST 2 TIMES THE BACKFILL HEIGHT.

CONDITIONS OF USE

- * STANDARD DRAWING – DESIGNER MUST ENSURE THE APPLICATION OF THIS DRAWING MEETS THE ASSUMPTIONS OF THE DESIGN AS STATED.
- * MAXIMUM ROOF SPAN OF 50'; MAXIMUM EAVE HEIGHT (TOP OF FOOTER TO BOTTOM OF TRUSS) OF 14'; AND MAXIMUM COLUMN SPACING OF 8'.
- * BACKFILL HEIGHT = 3' TO 4' (4' RECOMMENDED FOR FROST).
- * FOOTING MUST BE RESTRAINED WITH A FLOOR SLAB.
- * DRAINAGE CONDITION: FULL DRAINAGE, EITHER BY COARSE WELL DRAINED BACKFILL OR A DRAINAGE SYSTEM.
- * MINIMUM SUBGRADE BEARING CAPACITY = 2,000 psf

STANDARD DRAWING
4' TEE WALL WITH COLUMNS
WASTE STORAGE FACILITY

Designed **APM** 05-25-12
Drawn **DOH** 05-25-12
Checked **DEP** 05-25-12
Approved _____



Project Name
Drawing Name
MA-WSF-10
Sheet of